

TEST REPORT

REPORT NO. IN 42804 VOC
STANDARD NO: EN 60831-1
14/08/2021 -20/08/2021 P/I NO. : IR-20210523-2 dtd:23.05.2021

TEST DATE:

PRODUCT: 50 KVAR, 440V, 3PH, 50Hz, HEAVY DUTY FT CAP MPP TYPE CAPACITOR UNITS.

Sr. No.	REQUIREMENT /TEST	SPECIFICATIONS	RESULT	REMARK
1.	KVAR Rating	50 KVAR	50 KVAR	PASS
2.	Voltage Rating	440 V	440 V	PASS
3.	Basic Mfd value in Mfd	411 µfd	411µfd	PASS
4.	Sr. No. of the Capacitor	A88524	A88524	PASS
5.	Capacitor Type	Heavy Duty cap	Heavy Duty cap	PASS
6.	Frequency	50 HZ or 60HZ	50 HZ	PASS
7.1	Capacitance Measurement and Output Calculation before H ₂	-5% to +15% for units and ranges upto 100 KVAR	413 µfd	PASS
7.2	Capacitance Measurement and Output Calculation after H ₂	0% to 10% for units and ranges above 100 KVAR	413 µfd	PASS
8	Measurement of the tangent of the loss angle (tan δ) of the capacitor	Shall not exceed value declared by manufacture	0.48 Watt/Ar	PASS
9	Voltage tests between Terminals High Voltage test	2.15 x Rated Voltage for 2 sec	Withstood	PASS
10	Voltage tests between terminals and container	3 KV AC for 10 Sec	Withstood	PASS
11	Test of internal discharge device	In 3 min reduce to 75% or less	32 Sec	PASS
12	Sealing Test Leakage Test	75°C for 2 Hrs	No leakage	PASS
13	<p>Guide for Installation and Operation of L.T. Power Capacitors:</p> <p>General</p> <p>Choice of rated Voltage</p> <p>Operating temperature</p> <p>Installation</p> <p>High Ambient air temperature</p> <p>Evaluation of losses</p> <p>Special Service conditions</p> <p>Over voltages</p> <p>Overload currents</p> <p>Switching and protective devices and connections</p> <p>Capacitors connected to system with Audio frequency remote control</p> <p>EMC</p> <p>Immunity</p>		The installation manual attached	Pass



Shreem Electric Ltd.
Industrial Estate,
Jaysingpur - 416 144,
Dist. : Kolhapur, Maharashtra, (INDIA)

Tel : +91-2322-221021/22/24/45
Fax : +91-2322-221023
e-mail : info@shreemelectric.com
Web : www.shreemelectric.com



TEST REPORT


REPORT NO. IN 42804 VOC
STANDARD NO: EN 60831-1
14/08/2021 -20/08/2021 P/I NO. : IR-20210523-2 dtd:23.05.2021

TEST DATE:

PRODUCT: 50 KVAR, 440V, 3PH, 50Hz, HEAVY DUTY FT CAP MPP TYPE CAPACITOR UNITS.

RATING PLATE DETAILS

MANUFACTURER	M/s.ShreemElectric Ltd.
IDENTIFICATION NUMBER AND MANUFACTURING YEAR	A88524 08-2021
RATED OUTPUT Q_N IN KVAR	50Kvar
RATED VOLTAGE U_N IN VOLTS	440 volt
RATED FREQUENCY f_N IN Hz	50 HZ
TEMPERATURE CATEGORY	-40/D
DISCHARGE DEVICE	Ext.Fitted
REFERENCE OF SELF HEALING DESIGN	MPP (SH)
CONNECTION SYMBOL	Delta (Δ)
INTERNAL FUSES	No
INDICATION OF OVERPRESSURE OR THERMAL DISCONNECTOR	Provided Internally
INSULATION LEVEL U_i IN KV	3 Kv
REFERENCE TO IEC 60831	IEC 60831-1

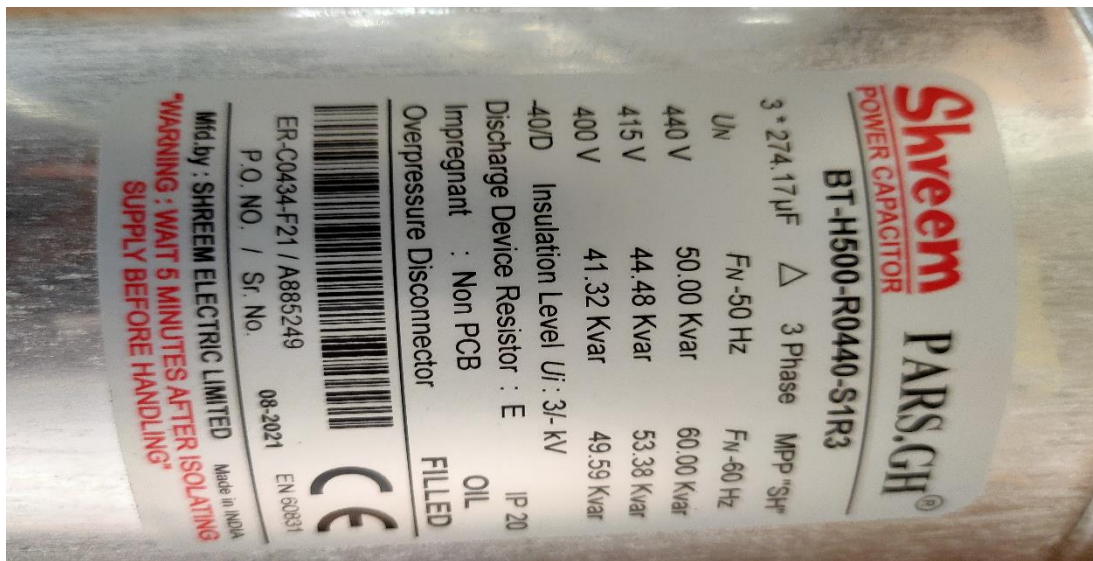

CONCLUSION: Place and date of inspection at Shreem Electric limited located in Kolhapur India on 14/08/2021 and the sample test performed by manufacturer from 14/08/2021 to 20/08/2021-. Sample test witnessed by our SAI inspector in laboratory of the manufacturer and concluded that the goods are in conformity with standard No.: EN 60831-1

Furthermore we confirm that the test report is acceptable and the manufacturer's laboratory found to be as qualified.
Manufacturer's Representative S.A.I. Representative

Abhate
SHREEM ELECTRIC LTD.
MPP Div.
Gat No. 311
Near R.K.Market
Yard Gate
JAYSINGPUR
Shreem Electric Ltd.
Industrial Estate,
Jaysingpur - 416 144,
Dist. : Kolhapur, Maharashtra, (INDIA)

Tel : +91-2322-221021/22/24/45
Fax : +91-2322-221023
e-mail : info@shreemelectric.com
Web : www.shreemelectric.com

